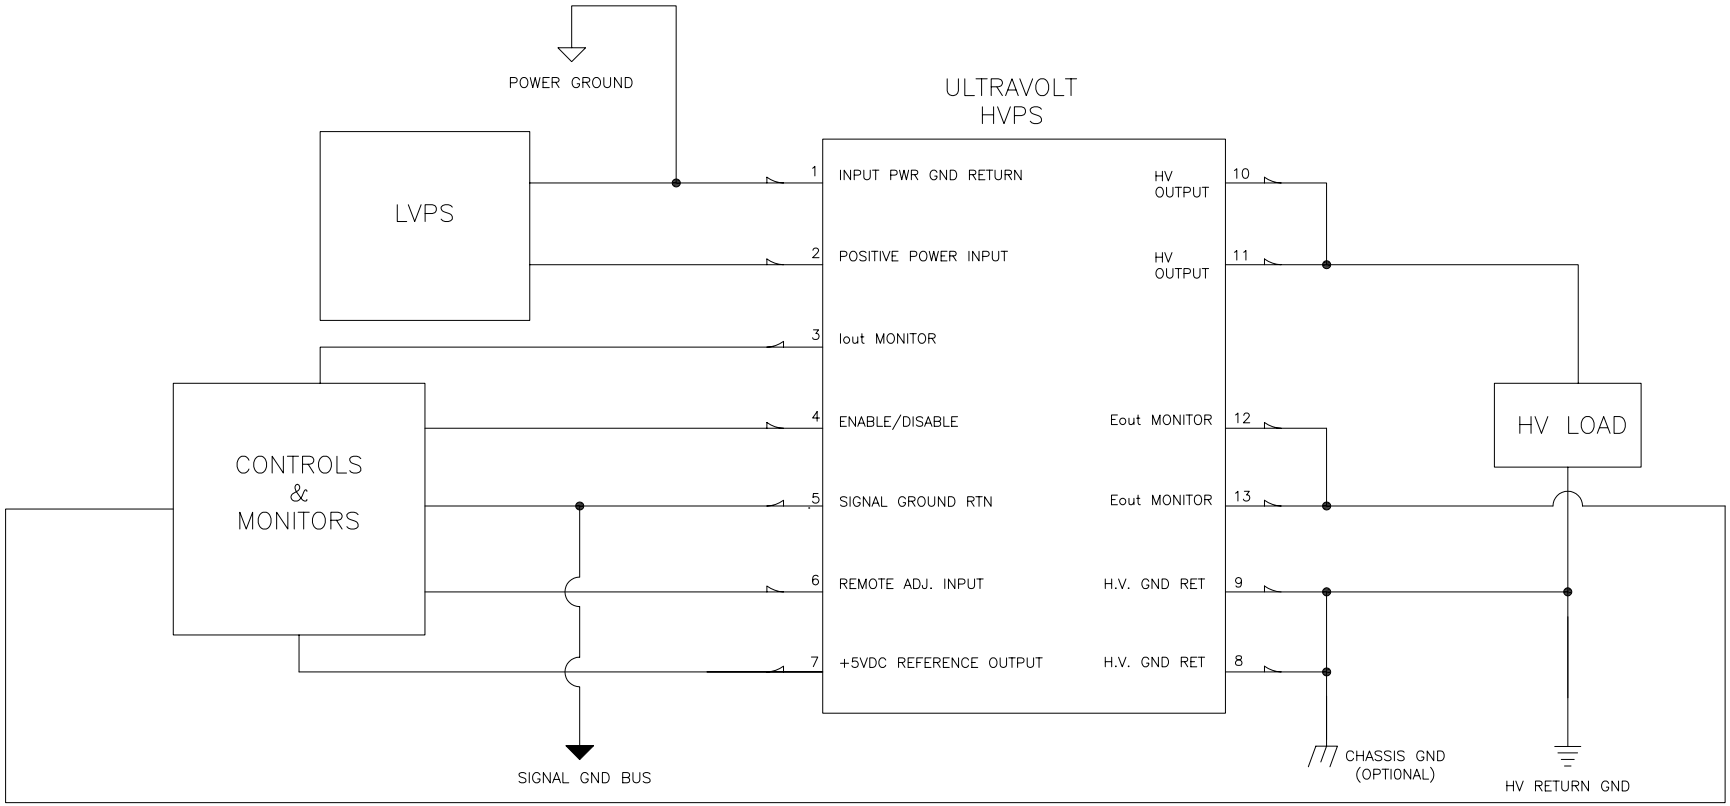

NOTES: REFER TO UV APPLICATION NOTES FOR MORE DETAILED INFORMATION
UV HVPS POWER UNPUT SHOULD NOT EXCEED +32VDC.
A 0.1uF 1.0 uF CAPACITOR CAN BE ADDED FROM REMOTE ADJUST
TO SIGNAL GROUND IN HIGH NOISE ENVIRONMENTS.

UltraVolt, Inc.
1800 Ocean Ave. Frnt
Ronkonkoma, NY 11779
1-631-471-4444

Title	RECOMMENDED HVPS GROUNDING CONFIGURATION	
Size A	Number UV-HVPS-CONN-16	Rev. B1
Date 6/1/00		Drawn By M.Z.
Filename UV-HVPS-CONN-16_revB1.dwg		Sheet 1 Of 1